

Sensis[®] Azure 2000s Four-pipe Aspirating Smoke Detector


[EN] 4020-100 – Azure 2000s 1A

[EN] 4021-100 – Azure 2000s 4A

(Pipe scanning)

[EN] 4022-100 – Azure 2000s 4A16

(Pipe scanning & Zone relay)

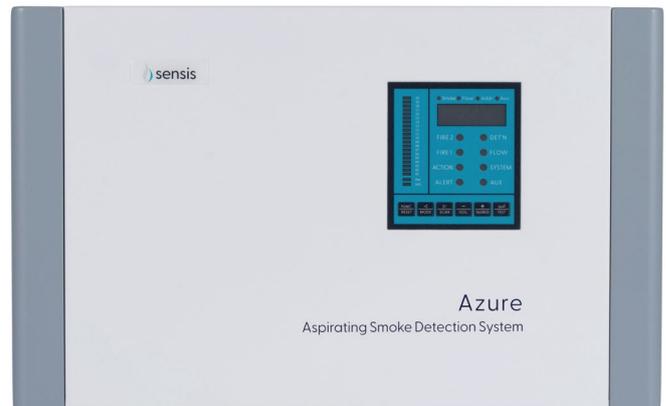

The Sensis Azure 2000s series offers industry-leading aspirating smoke detection technology, combining exceptional performance with cost-efficiency, specifically engineered for high ceilings and expansive open spaces, ensuring enhanced detection coverage and reliability in such specialized applications.

Utilising four independent Aspirators across upto four inlet pipes, the Sensis Azure 2000s uses a high-power Blue LED as its detection light source, with a short wavelength of 470 nm that is exceptionally sensitive to small smoke particles during the incipient stage of a fire. Employing Large Volume “Three-Dimension” detection, Sensis Azure 2000s has a specially engineered smoke chamber structure with a large total scattered light signal, enabling a more accurate representation of the actual concentration of smoke in the air.

The Smart Smoke Level (SSL) algorithm automatically activates upon power-up and gathers data on background environmental levels 24/7. The algorithm calculates the average background particle level and uses it as the reference point (zeroing) for detection, ensuring consistent performance and minimising nuisance alarms.

APPLICATIONS

Airports	Heritage buildings
Atrea	Lift shafts
Building voids	Manufacturing
Clean rooms	Telco
Cold storage	Warehouses
Data centres	Wash down
Food factories	

APPROVALS

EN54-20 approved. Worldwide approvals pending.
Visit ffeuk.com for up-to-date approvals information.

FEATURES

Very early warning smoke detection – Alarm sensitive range of 0.005-20% obs/m, covering a maximum area of up to 2,000 m².

High Power Blue LED – High Power Blue LED is a brighter light source with a shorter wavelength, which improves the response to smaller particles for earlier detection than conventional infra-red light sources.

Smart Smoke Level (SSL) – Operates 24/7 to continuously monitors the background environmental value and establishes a reference point for smoke concentration and alarm threshold to improve reliability and reduce false alarms.

3-in-1 display – Optimised user interface with 3-in-1 display providing real-time smoke levels (20 segment bargraph), 4 fire alarm indicators, 4 fault indicators and an isolator indicator.

Display Modes – Delivers real-time data including smoke value, normalised flow value (%), device address and event log. Configure all functional parameter settings from the device, such as alarm thresholds, fan speed and device address.

Programmer Mode – In Programmer Mode, users can configure all functional parameter settings such as alarm threshold adjustments, Fan speed alterations, and address changes.

Control Mode – The Control Mode enables users to execute various actions including Reset, Isolate/ De-isolate, Silence, and LED Test.

Signal output – 7 relays (configurable)
at 2 A @ 30 Vdc

SCAN THE QR CODE
TO EXPLORE THE SENSIS
PRODUCT RANGE



Sensis® Azure 2000s Four-pipe Aspirating Smoke Detector

PERFORMANCE

Smoke detection principle	Forward light scattering mass detection
Smoke detection range	0.001-25% obs/m
Alarm sensitivity range	0.005-20% obs/m
Area coverage	2,000 m ²
Aspirator speed	1 ~ 10
Major components	4 x Sampling Pipes 4 x Aspirators 4 x Flow Sensors 1 x High Sensitivity Smoke Detector 1 x Filter
Pipe length (linear)*	4 x 100 m (328 ft)
Pipe length (branch)*	4 x 240 m (787½ft)
EN54-20 Class A/B/C*	40/60/100
Alarm levels and time delay	
Alert	(0-60 seconds)
Action	(0-60 seconds)
Fire-1	(0-60 seconds)
Fire-2	(0-60 seconds)
Smart Smoke Learning (SSL) operation	24 hours, 365 days non-stop smoke background level learning
Flow detection principle	Heat mass detection
Flow monitoring	· Pipe flow normalize to 100% · Flow high and flow low fault · Adjustable flow detection sensitivity

MECHANICAL SPECIFICATION

Sampling pipe material	ABS/UPVC
OD	25 mm (1")
IP rating	IP40
Net weight	5.2 kg (11.5 lb)

***NOTE:** Per EN54-20 Class A Sensitivity. Please refer to the Sensis Design Manual for the details about pipe length and the number of sampling holes.

ELECTRICAL SPECIFICATION

Relay output	7 relays on termination board (configurable)
Rating	2 A @ 30 Vdc
Zone relay output (4A16 version)	16 relays on one Relay Board (configurable)
Rating	2 A @ 30 Vdc
General purpose inputs	8 x GPIs (configurable)
GPI functions	Reset/Isolate/Silence/Test/Scan/Mains Fault/Battery Fault/Power FaultSensitivity Mode 1/Sensitivity Mode 2/UDI-1/UDI-2/UDI-4/UDI-5*
NOTE: UDI, User Defined Input	

COMMUNICATION (2000S MODEL)

Network	RS-485 network
Max. no. of devices	250
Repeater	Built in
Max. cable length between two adjacent devices	1.2 km (3,937 ft)
Protocol	Support modbus RTU open protocol

EVENT LOGS

Number of events	183,000
Event type	Alarm/Fault/Operation/Smoke/Flow/Auxiliary Gas Sensors

OPERATING CONDITIONS




Ambient temp.	0-40°C (0-104°F)
Tested	-30°C~+55°C (-22-131°F)
Sampling air temp.	-20-60°C (-4-140°F)
Humidity	10-95% RH non-condensing
Operating voltage	24 ±4.8 Vdc 385 mA ~ 1050 mA

SCAN THE QR CODE
TO EXPLORE THE SENSIS
PRODUCT RANGE



Sensis® Azure 2000s Four-pipe Aspirating Smoke Detector

DIMENSIONS & INTERNAL STRUCTURE

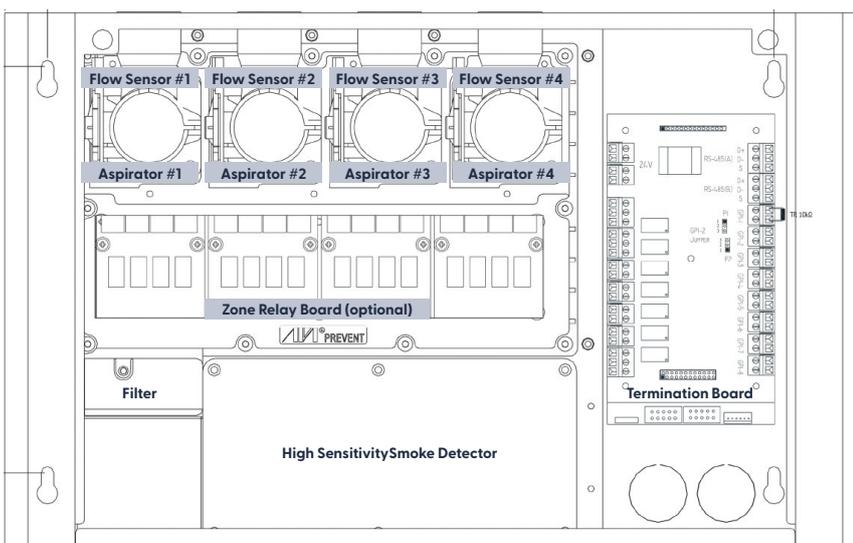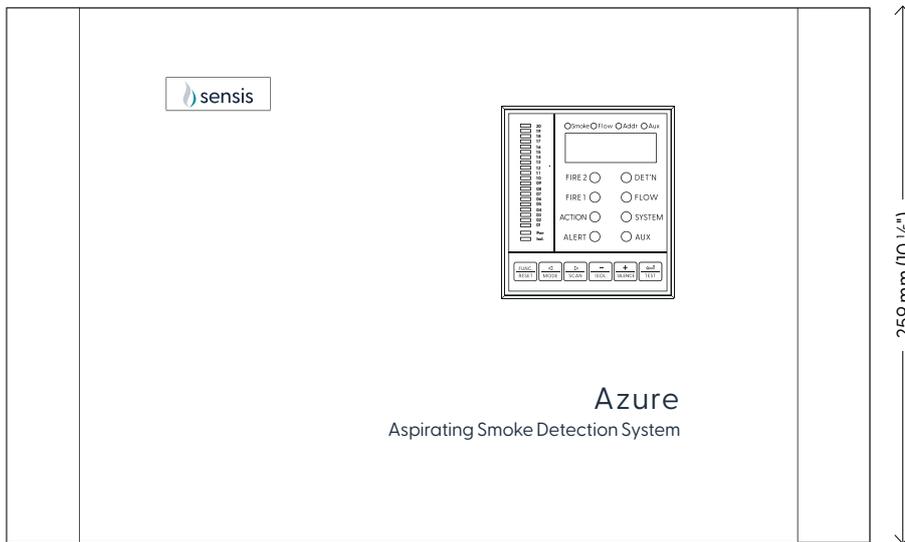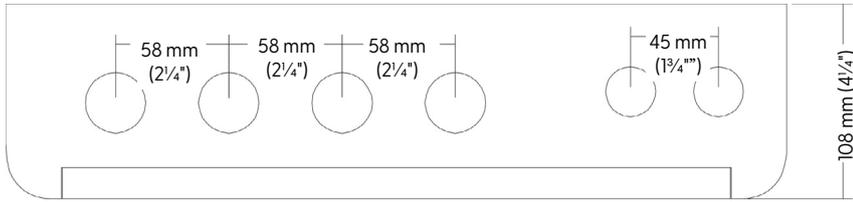

FFE Limited, 9 Hunting Gate, Hitchin, Hertfordshire SG4 0TJ, UK
 t: +44 (0) 1462 444 740 e: sales@ffeuk.com w: ffeuk.com

FFE Limited, 1455 Jamike Ave Ste 200, Erlanger, KY 41018-3147, USA
 t: +1 859 957 1570 e: america@ffeus.com w: ffeus.com

Specifications and wiring information are provided for information only and are believed to be accurate. FFE Ltd assumes no responsibility for their use. Data and design are subject to change without notice. Installation and wiring instructions are shipped with the products and should always be used for actual installation. For more information, contact your Sales Representative.
 Document Part No: 24-0437-02